


SB247 Lead in Drinking Water Testing at Schools and Childcare Facilities (Sept 2019)

- <1 to 5 ppb (85.1%)
- ✱ 5.1 to 10 ppb (7.2%)
- 10.1 to 15 ppb (2.6%)
- ▲ > 15 ppb (5.1%)

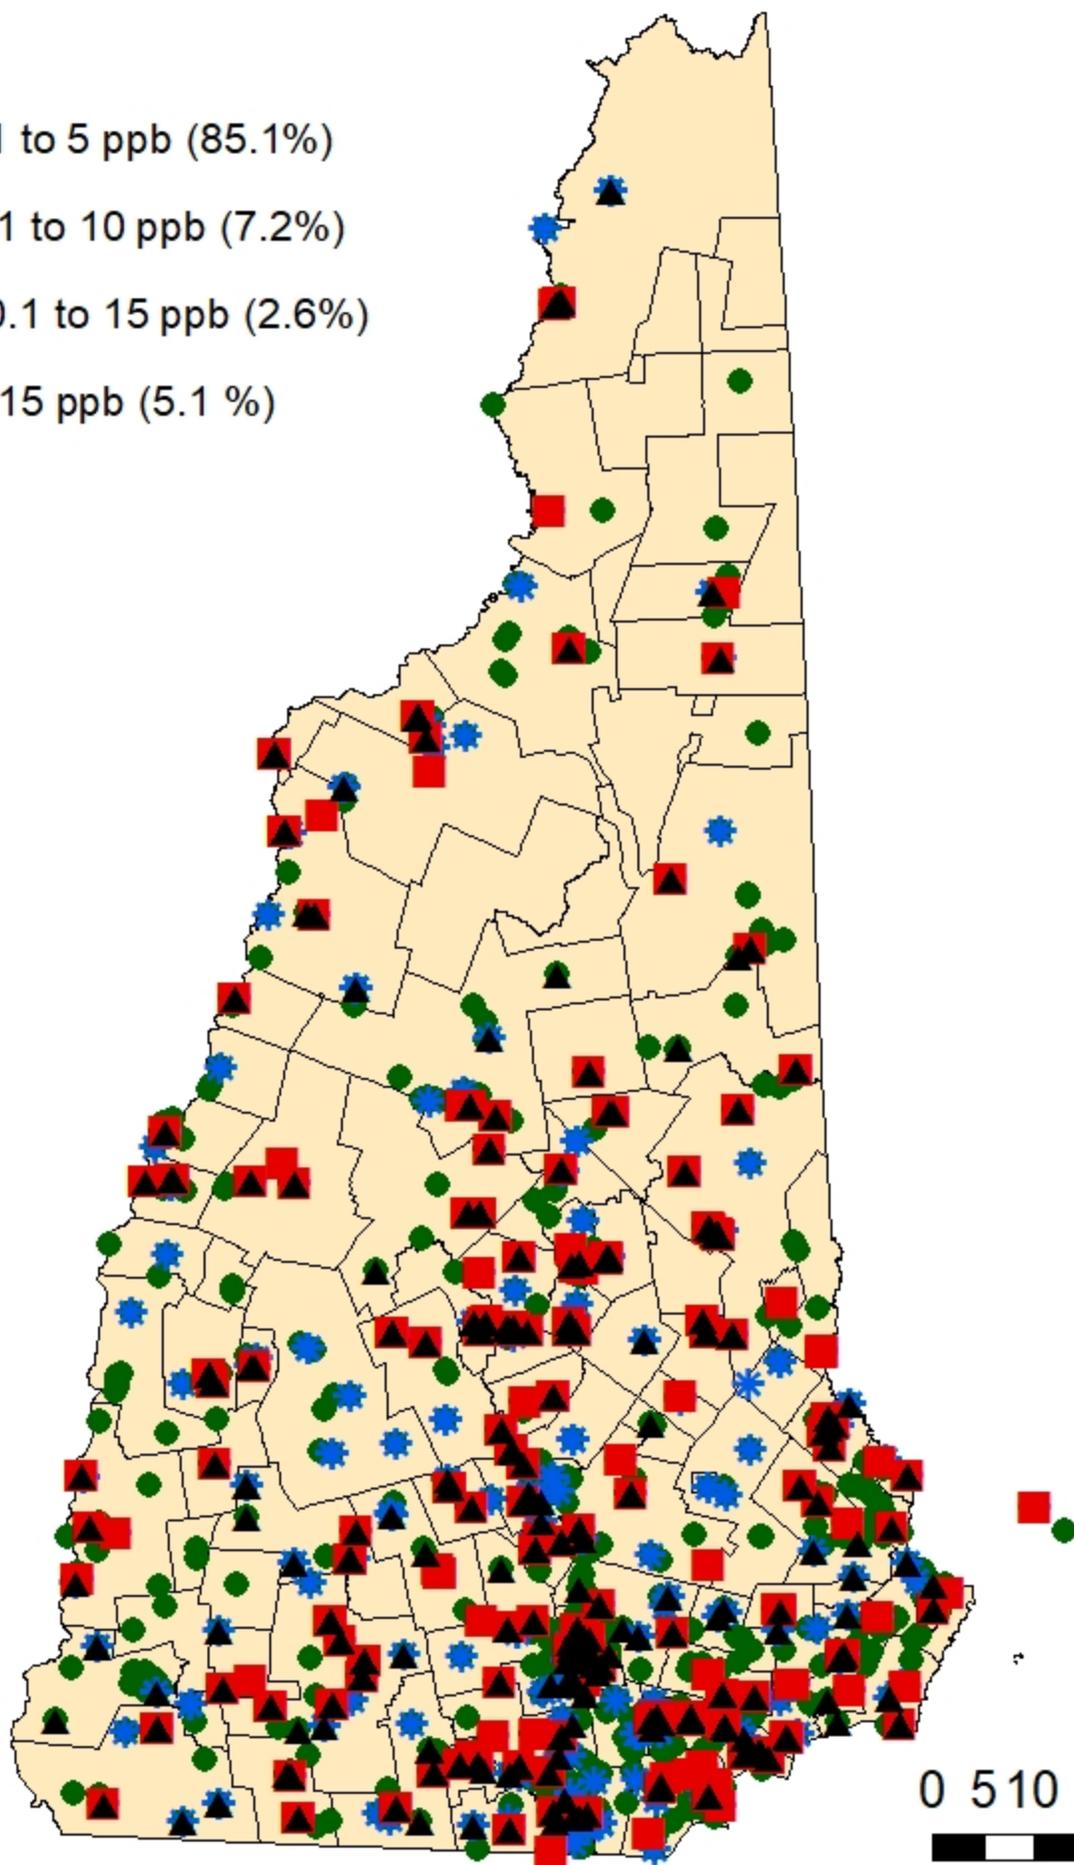

0 5 10 20
Miles